S.F.P.D LIMITED OUTDOOR LIGHTING DESIGN CARISBROOKE LAWN TENNIS CLUB FLOODLIGHT THREE TENNIS COURTS NRS 6 - 8

LIGHTING DESIGN P.A. 15 R1

Project Details

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 1 of 17

CONTENTS

PAGE 1 - TITLE PAGE

PAGE 2 - CONTENTS PAGE

PAGE 3 - DESIGN BRIEF

PAGE 4 - LIGHTING PERFORMANCE RESULTS ALL COURTS ON

PAGE 5 - LIGHTING PERFORMANCE RESULTS: OBTRUSIVE LIGHT

PAGE 6 - POSITIONS AND HEIGHTS OF LIGHT FITTINGS

PAGE 7 - OBJECTS WITHIN MODEL SPACE

PAGE 8 - OBJECTS WITHIN MODEL SPACE

PAGE 9 - LUX LEVEL CONTOUR PLOT OVER ORDNANCE SURVEY A3 : SITE

PAGE 10 - LUX LEVEL CONTOUR PLOT OVER ORDNANCE SURVEY A4 : SITE

PAGE 11 - ISOMETRIC OF PROPOSED COURT INSTALLATION - GENERAL

PAGE 12 - ISOMETRIC OF RESIDENTIAL DWELLINGS

PAGE 13 - PSUEDO COLOUR IMAGE OF THE PROPOSED SCHEME - PLAN VIEW

PAGE 14 - PSUEDO COLOUR IMAGE OF THE PROPOSED SCHEME - 3D VIEW

APPENDIX 1 - COMPLIANCE REPORT OBTRUSIVE OBTRUSIVE LIGHT VERTICAL ILLUMINANCE & CANDELA

APPENDIX 2 - PROPOSED LED LIGHT FITTING & COLUMN

APPENDIX 3 - ILP REDUCTION OF OBTRUSIVE LIGHT

Project Details

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025

Page 2 of 17

SFPD LIMITED OUTDOOR LIGHTING DESIGN FLOODLIGHT TWO EXISTING TENNIS COURT NRS 6 - 8 AT CARISBROOKE LAWN TENNIS CLUB

DESIGN CRITERIA.

To provide tennis court lighting scheme suitable for the L.T.A. recommended standard, whilst minimising sky glow, light spill and glare.

Performance standard applied to an individually switched court by court basis.

Results provided within this lighting design for two courts operating at the same time.

Court Principal Playing Area (P.P.A.) 500 lux with 0.7 uniformity. Design Grid L.T.A. 45 calculation points.

Court Total Playing Area (T.P.A.) 400 lux with 0.6 uniformity (limited by source intensity complince). Design Grid L.T.A. 117 calculation points.

Signify ClearFlood Gen 2 LED Panel Type Fitting Nominal 500 Watt 4000 Kelvin Colour Temperature.

All LED fittings have internal lourve around LED modules.

Identified fittings have front, side and rear external deflectors to control source intensity as indicated.

Mounting Height of Fittings 6.30M. Fittings installed within a tilt angle of less than 20 degrees.

Floodlight Columns 6.0m High. Columns and LED fittings positioned inside court block area

Obtrusive Ligh Calculations based on E3 Meduim District Brightness (Suburban) Zone.

Light Loss Factor 1.0 has been applied.

1.0, 2.0 & 5.0 Lux Outer Contour Lines Horiztontal Included.

Environmental Zone E3 Medium District Brighness ILP 2021/01 Guidance Note Reduction of Obtrusive Light.

Note: The LED fittings within this design have dimming factors applied and standard fittings cannot be used.

Lighting Design Software: AGI32 V22.1

CAD Software: AutoCad 2025

Designer: Lee West BSc. (Hons) MRICS MCIOB

Note: The nominal values shown in this design report are the result of precision calculations, based upon positioned luminaries in a fixed relationship to each other and to the area under examination. In practice the values may vary due to tolerances on luminaries, luminaire positioning, reflection properties and electrical supply.

Project Details

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 3 of 17

Luminaire Schedule								
Symbol	Qty	Label	Description	Lumens/Lamp	LLF	Lum. Watts	Total	
							Watts	
·	10	BVP657 T25LED9304S740 A55 MB LO	BVP657 T25LED9304S740 A55 MB LO 252L	93000	1.000	530.6	5306	
		252L L95 100KH 100 LLF	L95 100KH 100 LLF					
·	8	BVP657 T25LED9304S740 A55 NWB	BVP657 T25LED9304S740 A55 NWB LO 252L	93000	1.000	530.6	4244.8	
		LO 252L L95 100KH 100 LLF	L95 100KH 100 LLF					

Statistical Area Summary							
Label	Avg	Max	Min	Min/Avg	Meter Type	CalcType	Units
COURT NR 6 PPA - ALL ON	536.58	693.13	385.32	0.72	Horizontal	Illuminance	Lux
COURT NR 6 TPA - ALL ON	496.14	702.73	210.49	0.42	Horizontal	Illuminance	Lux
COURT NR 7 PPA - ALL ON	551.03	721.93	425.12	0.77	Horizontal	Illuminance	Lux
COURT NR 7 TPA - ALL ON	543.43	753.26	311.16	0.57	Horizontal	Illuminance	Lux
COURT NR 8 PPA - ALL ON	553.55	696.80	406.02	0.73	Horizontal	Illuminance	Lux
COURT NR 8 TPA - ALL ON	528.34	695.87	257.69	0.49	Horizontal	Illuminance	Lux

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 4 of 17

Luminaire Schedule								
Symbol	Qty	Label	Description	Lumens/Lamp	LLF	Lum. Watts	Total	
							Watts	
·	10	BVP657 T25LED9304S740 A55 MB LO	BVP657 T25LED9304S740 A55 MB LO 252L	93000	1.000	530.6	5306	
		252L L95 100KH 100 LLF	L95 100KH 100 LLF					
·	8	BVP657 T25LED9304S740 A55 NWB	BVP657 T25LED9304S740 A55 NWB LO 252L	93000	1.000	530.6	4244.8	
		LO 252L L95 100KH 100 LLF	L95 100KH 100 LLF					

Statistical Area Summary							
Label	Avg	Max	Min	Min/Avg	Meter Type	CalcType	Units
ObtrusiveLight 1 Carisbrooke Pk_Cd_Seg1	77.70	168	41	0.53	Vert-PerpCCW	Obtrusive - Cd	N.A.
ObtrusiveLight 1 Carisbrooke Pk_III_Seg1	0.23	0.53	0.10	0.43	Vert-PerpCCW	Obtrusive - III	Lux
ObtrusiveLight 14 Carisbrooke Pk_Cd_Seg1	136.69	175	107	0.78	Vert-PerpCW	Obtrusive - Cd	N.A.
ObtrusiveLight 14 Carisbrooke Pk_III_Seg1	0.42	0.73	0.21	0.50	Vert-PerpCCW	Obtrusive - III	Lux
ObtrusiveLight 2 Carisbrooke Pk_Cd_Seg1	84.31	158	42	0.50	Vert-PerpCW	Obtrusive - Cd	N.A.
ObtrusiveLight 2 Carisbrooke Pk_III_Seg1	0.26	0.48	0.10	0.38	Vert-PerpCCW	Obtrusive - III	Lux
ObtrusiveLight 3 Carisbrooke Pk 2_Cd_Seg1	89.58	125	41	0.46	Vert-PerpCW	Obtrusive - Cd	N.A.
ObtrusiveLight 3 Carisbrooke Pk 2_III_Seg1	0.16	0.31	0.05	0.31	Vert-PerpCCW	Obtrusive - III	Lux
Site Area	13.42	731.8	0.0	0.00	Horizontal	Illuminance	Lux

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 5 of 17

Luminaire Location Sum	nmary						
UserField5	Label	X	Y	Z	Orient	LumNo	Switch
							ed
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	-8.806	-23.237	6.3	48.441	101	On
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	-16.16	-15.236	6.3	43.167	102	On
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	-24.162	-6.443	6.3	43.167	103	On
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	6.879	-17.992	6.3	138.395	104	On
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	-5.78	-4.235	6.3	223.315	105	On
Tennis Court Nr 8	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	-17.728	8.107	6.3	308.203	106	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	7.565	-17.346	6.3	128.315	107	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	-4.739	-4.628	6.3	43.411	108	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	-17.042	8.754	6.3	318.048	109	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	17.659	-8.948	6.3	138.395	110	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	5.614	4.159	6.3	223.315	111	On
Tennis Court Nr 7	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	-7.566	17.758	6.3	308.203	112	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	18.345	-8.302	6.3	128.315	113	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	6.655	3.766	6.3	43.411	114	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 NWB LO 252L L95 100KH 100 LLF	-6.88	18.405	6.3	318.048	115	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	25.603	5.563	6.3	218.331	116	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	18.32	13.631	6.3	223.31	117	On
Tennis Court Nr 6	BVP657 T25LED9304S740 A55 MB LO 252L L95 100KH 100 LLF	10.416	22.516	6.3	223.31	118	On

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 6 of 17

Object Summary		
Label	Type	Description
1 Carisbrooke Park	Polygon-Flat	House 5.5m High
14 Carisbrooke Park	Polygon-Flat	Bungalow 3.0m High
2 Carisbrooke Park	Polygon-Flat	House 5.5m High
3 Carisbrooke Park	Polygon-Flat	House 5.5m High
Floodlight Column Nr 1	Round-Flat	Column 6.0m High
Floodlight Column Nr 10	Round-Flat	Column 6.0m High
Floodlight Column Nr 11	Round-Flat	Column 6.0m High
Floodlight Column Nr 12	Round-Flat	Column 6.0m High
Floodlight Column Nr 2	Round-Flat	Column 6.0m High
Floodlight Column Nr 3	Round-Flat	Column 6.0m High
Floodlight Column Nr 4	Round-Flat	Column 6.0m High
Floodlight Column Nr 5	Round-Flat	Column 6.0m High
Floodlight Column Nr 6	Round-Flat	Column 6.0m High
Floodlight Column Nr 7	Round-Flat	Column 6.0m High
Floodlight Column Nr 8	Round-Flat	Column 6.0m High
Floodlight Column Nr 9	Round-Flat	Column 6.0m High
Front Deflector CF 11	Polygon-Flat	600mm x 50mm Front Plate
Front Deflector CF 12	Polygon-Flat	600mm x 50mm Front Plate
Front Deflector CF 6	Polygon-Flat	600mm x 50mm Front Plate
Front Deflector CF 7	Polygon-Flat	600mm x 50mm Front Plate
Front Deflector CF 8	Polygon-Flat	600mm x 50mm Front Plate
Front Deflector CF 9	Polygon-Flat	600mm x 50mm Front Plate
Rear Deflector CF 01	Polygon-Flat	600mm x 500mm Rear Plate
Rear Deflector CF 2	Polygon-Flat	600mm x 500mm Rear Plate
Rear Deflector CF 3	Polygon-Flat	600mm x 500mm Rear Plate
Rear Deflector CF 4	Polygon-Flat	600mm x 500mm Rear Plate
Side Deflector CF 10	Polygon-Flat	400mm x 100mm Side Plate
Side Deflector CF 5	Polygon-Flat	400mm x 200mm Side Plate

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 7 of 17

Object Summary			
Label	Type	Description	
Site Area	Planar		
Timber Fence Nr 1	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 10	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 2	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 3	Polygon-Flat	Timber 1.0m	
Timber Fence Nr 4	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 5	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 6	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 7	Polygon-Flat	Timber 1.0m High	
Timber Fence Nr 8	Polygon-Flat	Timber 1.0m High	-
Timber Fence Nr 9	Polygon-Flat	Timber 1.0m High	

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED


39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 8 of 17

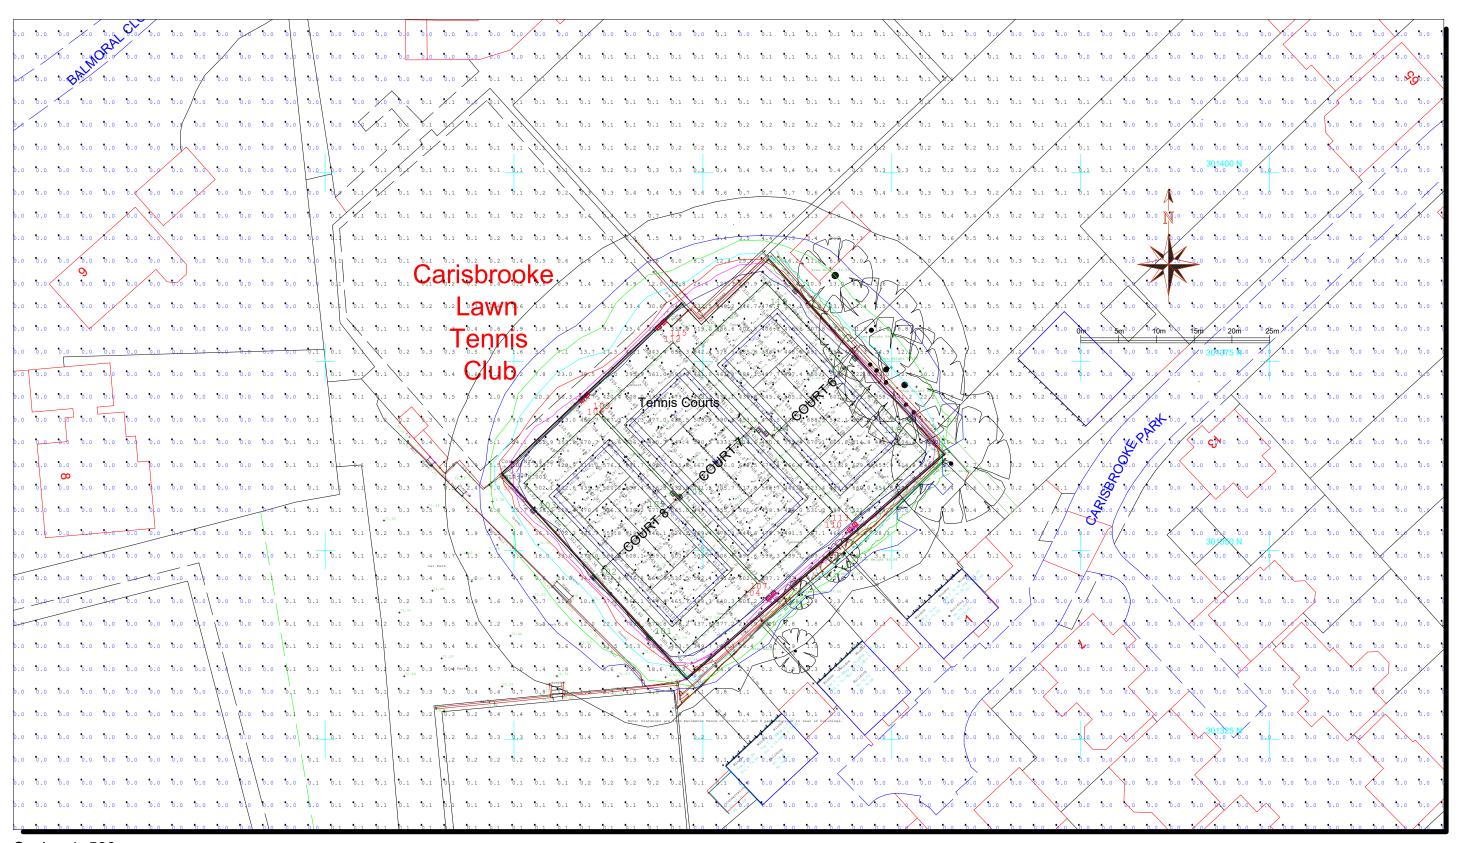

Scale= 1: 500

Project Details

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED


39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK

Date : 23.05.2025 Page 9 of 17



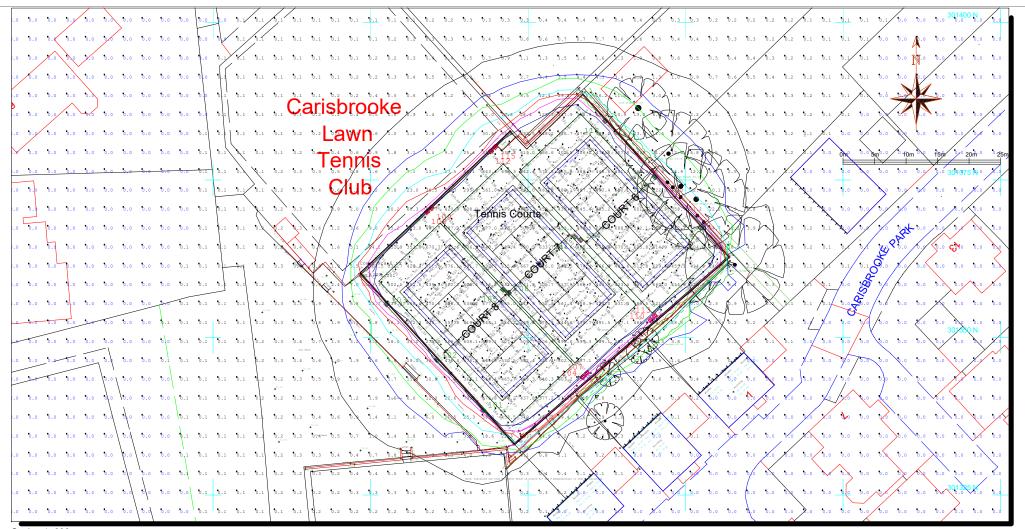

Scale= 1: 600

Project Details

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259


WEB: WWW.SFPAD.CO.UK





Date: 23.05.2025

Page 10 of 17

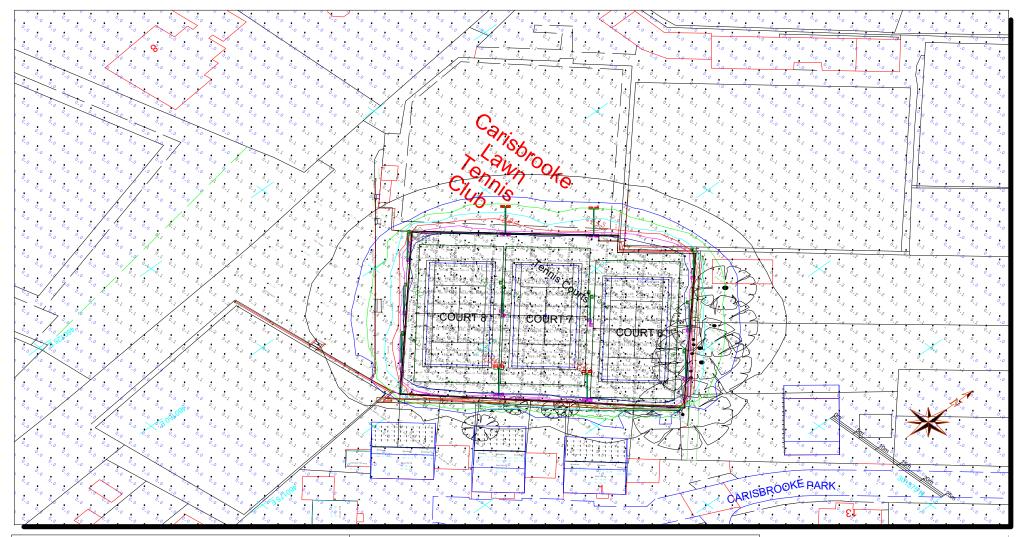

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED


39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 11 of 17

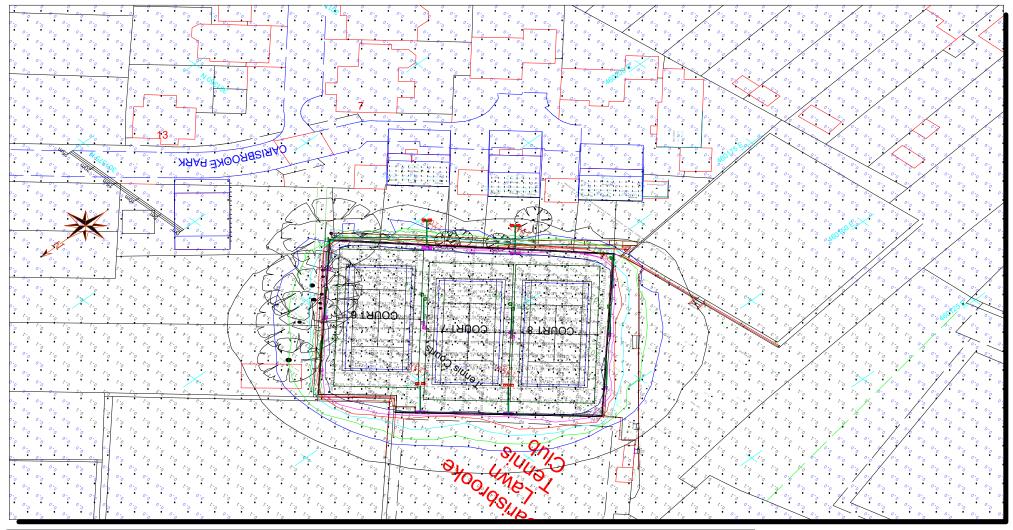

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6-8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.


TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK

Date: 23.05.2025



Page 12 of 17

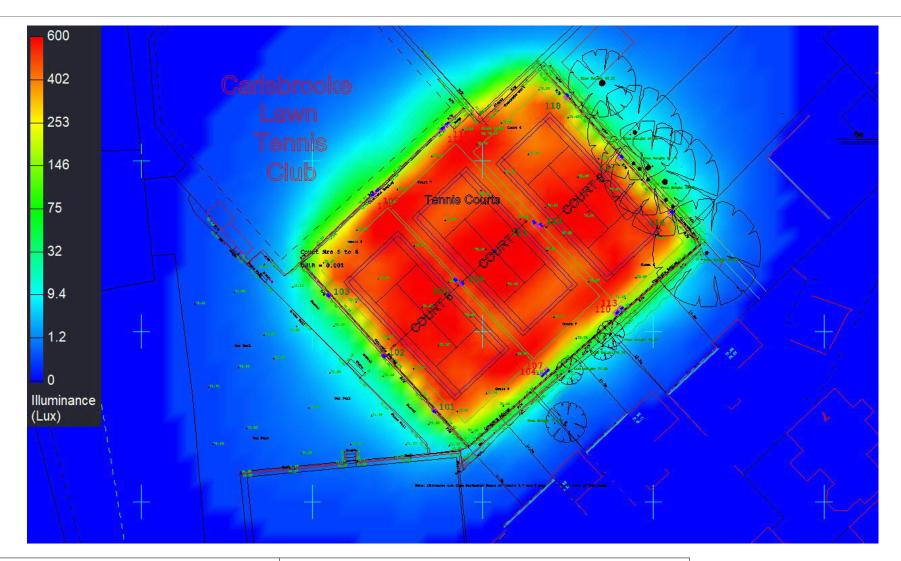

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED


39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 13 of 17

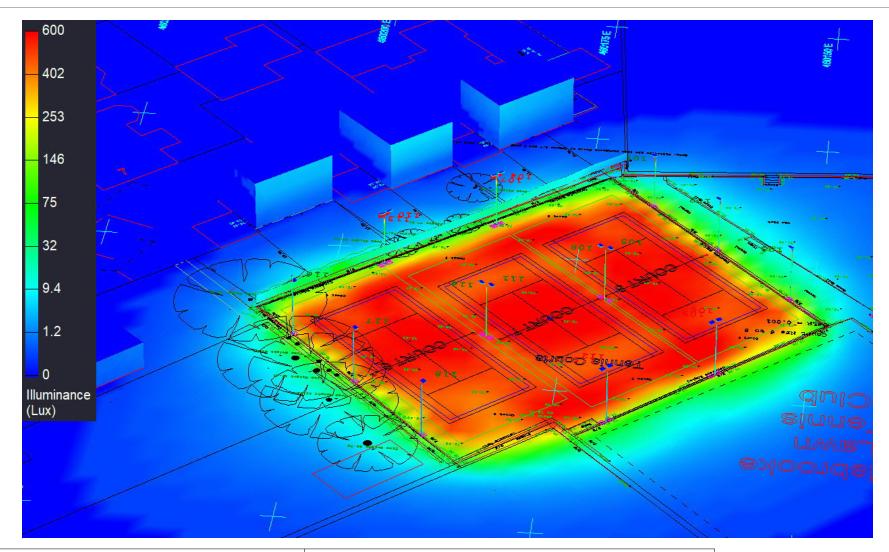

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL: OFFICE@SFPAD.CO.UK WEB: WWW.SFPAD.CO.UK



Date: 23.03.2025 Page 14 of 17

APPENDIX 1 - OBTRUSIVE LIGHT COMPLIANCE REPORT ILP 2021/01 VERTICAL LUX AND CANDELA

Project Details

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.03.2025 Page 15 of 17

Obtrusive Light - Compliance Report CIE 150:2017, E3-Medium District Brightness, Pre-Curfew

Filename: CARISBROOKE LTC NRS 6 TO 8 LIGHTING DESIGN PA 15 R1 SIGNIFY

23/05/2025

Illuminance

Maximum Allowable Value: 10 Lux

Calculations Tested (4):

Calculations rested (1).	Test	Max.
Calculation Label	Results	Illum.
ObtrusiveLight 3 Carisbrooke Pk 2_III_Seg1	PASS	0.31
ObtrusiveLight 2 Carisbrooke Pk_III_Seg1	PASS	0.48
ObtrusiveLight 1 Carisbrooke Pk_III_Seg1	PASS	0.53
ObtrusiveLight 14 Carisbrooke Pk III Seg1	PASS	0.73

Luminous Intensity (Cd) At Vertical Planes

Maximum Allowable Value calculated from CIE 150:2017 (varies by Projected Area sq.m. and Distance Factor) For E3-Medium District Brightness, Projected Area and Distance Factors: (0.002, 0.86) (0.01, 1.9) (0.03, 3.8) (0.13, 7.5) (0.5, 15)

Calculations Tested (4):

	Test
Calculation Label	Results
ObtrusiveLight 3 Carisbrooke Pk 2_Cd_Seg1	PASS
ObtrusiveLight 2 Carisbrooke Pk_Cd_Seg1	PASS
ObtrusiveLight 1 Carisbrooke Pk_Cd_Seg1	PASS
ObtrusiveLight 14 Carisbrooke Pk Cd Seg1	PASS

Upward Waste Light Ratio (UWLR)

Maximum Allowable Value: 5.0 %

Calculated UWLR: 0.1 %

Test Results: PASS

Upward Flux Ratio (UFR)

Maximum Allowable Value: 6.0

Reference Area(s): COURT NRS 6 TO 8 BLOCK

Average Reflectance - Reference Area(s): 0.20 Average Reflectance - Surround: 0.10 Initial Average Illuminance - Reference Area(s): 473.57 Lux Average Maintained Illuminance Required: 500.00 Lux Total Area - Reference Area(s): 1719 Sq.m. Total Luminaire Flux (All Locations): 1674000 Downward Light Ratio (DLO): 0.999 Upward Light Ratio (ULO): 0.001 Utilization Factor (UF): 0.486

Calculated UFR: 1.46

Test Results: PASS

APPENDIX 2 - LUMINAIRE DETAILS & COLUMN DETAILS

Project Details

PROJECT : FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 16 of 17





Clearflood gen2: Your optimized TCO solution for general area and recreational sports projects

Clearflood gen2

This new generation of Clearflood range brings the total cost of ownership of your project to the next level. The range comes in 3 sizes (BVP655, BVP656, BVP657) with several finishing and serviceability options, and leverages on the light engine of our Recreational Sports & Area flagship floodlight. This light engine is optimised for sports applications, as well as large areas, such as logistical hubs, outdoor car parks and storage areas. Now an innovative design approach allows the availability of connected options such as the SR socket, fully integrated on the floodlight housing, and a multi-sensor on the bracket. The product range is compatible with Interact systems.

Benefits

- Optimized total cost of ownership thanks to a good balance between initial investment and operational costs
- · Compatible with Interact systems
- · Choose your serviceability level and finishing
- · Long lasting, robust design


Features


- \cdot Features dedicated Sports&Area light engine and optics
- · 3 different sizes (BVP655, BVP656, BVP657)
- CCT available from 2700K to 5700K
- · Electrical class I and II
- IP66, IK08
- · Serviceability options: toolless opening or fixed glass
- Finishing options: raw, standard, marine protection (MSP), swimming pool protection (SPO)
- · Connectivity options: SR socket, OLC node and multi-sensor options are available


Application


- · Arena and Sports
- Airports
- Manufacturing
- Warehouses
- Harbor


Dimensional drawing














Product details

Opening without tool





Fixed glass

Combo SR node and OSB sensor





SR socket on bracket





General Information	
Driver included	Yes
Service Tag	Yes
Light Technical	
Light source colour	740 neutral white
Correlated Colour Temperature (Nom)	4000 K
Colour rendering index (CRI)	70
Optic type outdoor	Asymmetrical
Upwards light output ratio	0
Operating and Electrical	
Surge Protection (Common/	6/8 kV
Differential)	
Controls and Dimming	
Dimmable	No
Mechanical and Housing	
Optical cover type	Clear glass
Housing Colour	Aluminium
Mech. impact protection code	IK08
Ingress protection code	IP66
Standard tilt angle side entry	-
Standard tilt angle post-top	-
Approval and Application	
CE mark	Yes
Flammability mark	-

General Information

oc.ic.at iii	Torritation		
Order Code	Full Product Name	Lamp family code	Number of gear units
79626300	BVP657 LED930-4S/740 PSU A65-WB ALU	LED930	3 units
79627000	BVP657 LED930-4S/740 PSU A55-MB ALU	LED930	3 units
79628700	BVP657 LED930-4S/740 PSU A65-VWB ALU	LED930	3 units
79629400	BVP657 LED930-4S/740 PSU A35-MB ALU	LED930	3 units
79630000	BVP657 LED930-4S/740 PSU DW10 ALU	LED930	3 units
79631700	BVP657 LED930-4S/740 PSU DW30 ALU	LED930	3 units
79632400	BVP657 LED930-4S/740 PSU A65-NWB ALU	LED930	3 units
79619500	BVP656 LED600-4S/740 PSU A65-WB ALU	LED600	2 units
79620100	BVP656 LED600-4S/740 PSU A55-MB ALU	LED600	2 units
79621800	BVP656 LED600-4S/740 PSU A65-VWB ALU	LED600	2 units
79622500	BVP656 LED600-4S/740 PSU A35-MB ALU	LED600	2 units
79623200	BVP656 LED600-4S/740 PSU DW10 ALU	LED600	2 units
79624900	BVP656 LED600-4S/740 PSU DW30 ALU	LED600	2 units
79625600	BVP656 LED600-4S/740 PSU A65-NWB ALU	LED600	2 units
79612600	BVP655 LED300-4S/740 PSU A65-WB ALU	LED300	Unit
79613300	BVP655 LED300-4S/740 PSU A55-MB ALU	LED300	Unit
79614000	BVP655 LED300-4S/740 PSU A65-VWB ALU	LED300	Unit
79615700	BVP655 LED300-4S/740 PSU A35-MB ALU	LED300	Unit
79616400	BVP655 LED300-4S/740 PSU DW10 ALU	LED300	Unit
79617100	BVP655 LED300-4S/740 PSU DW30 ALU	LED300	Unit
79618800	BVP655 LED300-4S/740 PSU A65-WNB ALU	LED300	Unit

Light Technical

•							
		Luminaire light beam				Luminaire light beam	
Order Code	Full Product Name	spread	Luminous Flux	Order Code	Full Product Name	spread	Luminous Flux
79626300	BVP657 LED930-4S/740 PSU	5° - 13° x 128°	70,450 lm	79621800	BVP656 LED600-4S/740 PSU	5° - 16° x 149°	47,660 lm
	A65-WB ALU				A65-VWB ALU		
79627000	BVP657 LED930-4S/740 PSU	5° - 17° x 97°	76,900 lm	79622500	BVP656 LED600-4S/740 PSU	6° - 21° x 99°	51,160 lm
	A55-MB ALU				A35-MB ALU		
79628700	BVP657 LED930-4S/740 PSU	5° - 16° x 149°	73,580 lm	79623200	BVP656 LED600-4S/740 PSU	26° - 22° x 147°	50,490 lm
	A65-VWB ALU				DW10 ALU		
79629400	BVP657 LED930-4S/740 PSU	6° - 21° x 99°	78,980 lm	79624900	BVP656 LED600-4S/740 PSU	35° - 17° x 122°	50,699 lm
	A35-MB ALU				DW30 ALU		
79630000	BVP657 LED930-4S/740 PSU	26° - 22° x 147°	78,539 lm	79625600	BVP656 LED600-4S/740 PSU	6° - 14° x 122°	46,430 lm
	DW10 ALU				A65-NWB ALU		
79631700	BVP657 LED930-4S/740 PSU	35° - 17° x 122°	78,863 lm	79612600	BVP655 LED300-4S/740 PSU	5° - 13° x 128°	23,100 lm
	DW30 ALU				A65-WB ALU		
79632400	BVP657 LED930-4S/740 PSU	6° - 14° x 122°	71,680 lm	79613300	BVP655 LED300-4S/740 PSU	5° - 17° x 97°	25,220 lm
	A65-NWB ALU				A55-MB ALU		
79619500	BVP656 LED600-4S/740 PSU	5° - 13° x 128°	45,630 lm	79614000	BVP655 LED300-4S/740 PSU	5° - 16° x 149°	24,130 lm
	A65-WB ALU				A65-VWB ALU		
79620100	BVP656 LED600-4S/740 PSU	5° - 17° x 97°	49,810 lm	79615700	BVP655 LED300-4S/740 PSU	6° - 21° x 99°	25,900 lm
	A55-MB ALU				A35-MB ALU		

		Luminaire light beam	
Order Code	Full Product Name	spread	Luminous Flux
79616400	BVP655 LED300-4S/740 PSU	26° - 22° x 147°	25,488 lm
	DW10 ALU		
79617100	BVP655 LED300-4S/740 PSU	35° - 17° x 122°	25,431 lm
	DW30 ALU		

		Luminaire light beam	
Order Code	Full Product Name	spread	Luminous Flux
79618800	BVP655 LED300-4S/740 PSU	6° - 14° x 122°	23,510 lm
	A65-WNB ALU		

Operating and Electrical

0930-4S/740 PSU A65-WB ALU 0930-4S/740 PSU A55-MB ALU	530 W
930-4S/740 PSU A55-MB ALU	E20 W
	330 W
930-4S/740 PSU A65-VWB ALU	530 W
930-4S/740 PSU A35-MB ALU	530 W
930-4S/740 PSU DW10 ALU	530 W
930-4S/740 PSU DW30 ALU	530 W
930-4S/740 PSU A65-NWB ALU	530 W
0600-4S/740 PSU A65-WB ALU	341 W
0600-4S/740 PSU A55-MB ALU	341 W
0600-4S/740 PSU A65-VWB ALU	341 W
0600-4S/740 PSU A35-MB ALU	341 W
	D930-4S/740 PSU A65-VWB ALU D930-4S/740 PSU A35-MB ALU D930-4S/740 PSU DW10 ALU D930-4S/740 PSU DW30 ALU D930-4S/740 PSU DW30 ALU D930-4S/740 PSU A65-NWB ALU D600-4S/740 PSU A65-WB ALU D600-4S/740 PSU A65-VWB ALU D600-4S/740 PSU A65-VWB ALU


Order Code	Full Product Name	Power Consumption
79623200	BVP656 LED600-4S/740 PSU DW10 ALU	341 W
79624900	BVP656 LED600-4S/740 PSU DW30 ALU	341 W
79625600	BVP656 LED600-4S/740 PSU A65-NWB ALU	341 W
79612600	BVP655 LED300-4S/740 PSU A65-WB ALU	172 W
79613300	BVP655 LED300-4S/740 PSU A55-MB ALU	172 W
79614000	BVP655 LED300-4S/740 PSU A65-VWB ALU	172 W
79615700	BVP655 LED300-4S/740 PSU A35-MB ALU	172 W
79616400	BVP655 LED300-4S/740 PSU DW10 ALU	172 W
79617100	BVP655 LED300-4S/740 PSU DW30 ALU	172 W
79618800	BVP655 LED300-4S/740 PSU A65-WNB ALU	172 W

Product Data


Order Code	Full Product Name	Product family code
79626300	BVP657 LED930-4S/740 PSU A65-WB ALU	BVP657
79627000	BVP657 LED930-4S/740 PSU A55-MB ALU	BVP657
79628700	BVP657 LED930-4S/740 PSU A65-VWB ALU	BVP657
79629400	BVP657 LED930-4S/740 PSU A35-MB ALU	BVP657
79630000	BVP657 LED930-4S/740 PSU DW10 ALU	BVP657
79631700	BVP657 LED930-4S/740 PSU DW30 ALU	BVP657
79632400	BVP657 LED930-4S/740 PSU A65-NWB ALU	BVP657
79619500	BVP656 LED600-4S/740 PSU A65-WB ALU	BVP656
79620100	BVP656 LED600-4S/740 PSU A55-MB ALU	BVP656
79621800	BVP656 LED600-4S/740 PSU A65-VWB ALU	BVP656
79622500	BVP656 LED600-4S/740 PSU A35-MB ALU	BVP656

Order Code	Full Product Name	Product family code
79623200	BVP656 LED600-4S/740 PSU DW10 ALU	BVP656
79624900	BVP656 LED600-4S/740 PSU DW30 ALU	BVP656
79625600	BVP656 LED600-4S/740 PSU A65-NWB ALU	BVP656
79612600	BVP655 LED300-4S/740 PSU A65-WB ALU	BVP655
79613300	BVP655 LED300-4S/740 PSU A55-MB ALU	BVP655
79614000	BVP655 LED300-4S/740 PSU A65-VWB ALU	BVP655
79615700	BVP655 LED300-4S/740 PSU A35-MB ALU	BVP655
79616400	BVP655 LED300-4S/740 PSU DW10 ALU	BVP655
79617100	BVP655 LED300-4S/740 PSU DW30 ALU	BVP655
79618800	BVP655 LED300-4S/740 PSU A65-WNB ALU	BVP655


Polar Wide Diagrams



Polar Normal (separate) - BVP656I -912300060560




Polar Normal (separate) - BVP656I -912300060564




Polar Normal (separate) - BVP655I - 912300060556


Polar Wide Diagrams




Polar Normal (separate) - BVP656I - 912300060561




Polar Normal (separate) - BVP655I - 912300060554




Polar Normal (separate) - BVP655I - 912300060555




Polar Normal (separate) - BVP655I -912300060553




Polar Normal (separate) - BVP657I -912300060567




Polar Normal (separate) - BVP657I -912300060569



Polar Normal (separate) - BVP655I -912300060557




Polar Normal (separate) - BVP657I - 912300060566




Polar Normal (separate) - BVP655I -912300060551


Polar Wide Diagrams




Polar Normal (separate) - BVP656I - 912300060562




Polar Normal (separate) - BVP656I - 912300060558




Polar Normal (separate) - BVP655I - 912300060552




Polar Normal (separate) - BVP657I -912300060571




Polar Normal (separate) - BVP657I -912300060568




Polar Normal (separate) - BVP657I -912300060565



Polar Normal (separate) - BVP656I -912300060559



Polar Normal (separate) - BVP656I -912300060563



Polar Normal (separate) - BVP657I -912300060570





© 2024 Signify Holding All rights reserved. Signify does not give any representation or warranty as to the accuracy or completeness of the information included herein and shall not be liable for any action in reliance thereon. The information presented in this document is not intended as any commercial offer and does not form part of any quotation or contract, unless otherwise agreed by Signify. All trademarks are owned by Signify Holding or their respective owners.

HEAVY DUTY

5-12M TUBULAR STEEL

Designed to EN40. Hot dip galvanised to BS EN ISO 1461:2009. Manufactured in steel tube to EN10210

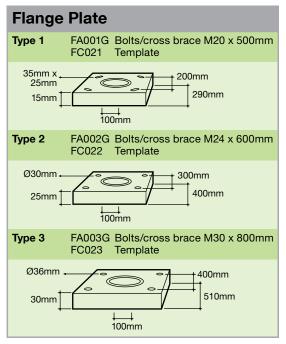

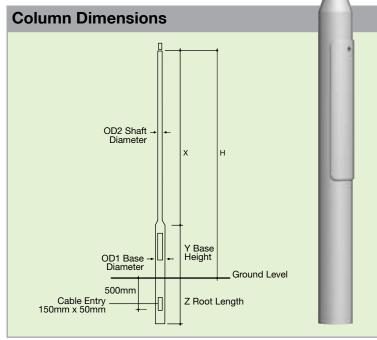

Accessories

ELSAB1/6A Single fuse cut-out, 6A, loop in/out (not fitted) ELSAB12/6A Twin fuse cut-out, 6A, loop in/out (not fitted)

Root Mounted

Dimensions (mm)								Ô			
Product							Door	Weight	OTM	Shear	Min. Concrete
Code	Height	OD1	OD2	Х	У	Z	Opening	(kg)	(kNm)	(kN)	Diameter*
TB058	5m	168	114	3675	1250	1000	600x115	59	9.1	2.1	575
TB068	6m	168	114	4660	1250	1000	600x115	67	9.0	1.8	556
TB088/H	8m	194	114	6630	1250	1200	600x115	101	13.0	2.2	467
TB108/H/SP†	10m	194	140/127	8370	1250	1500	600x115	158	19.5	2.5	358
TB128/H/SP†	12m	219	168/152	9840	1750	1700	600x115	257	36.4	3.9	454

^{*}Root concrete diameter based on poor soil or better, min. 230kN/m² per m

Flange Plate Mounted

Dimensions (mm)			<u></u>					Ô			s H
Product Code	Height	OD1	OD2	х	у	Door Opening	Flange Plate	Weight (kg)	OTM (kNm)	Shear (kN)	Concrete Dimension*
TB058/FP	5m	168	114	3675	1250	600x115	Type 1	75	9.1	2.1	900 x 950
TB068/FP	6m	168	114	4660	1250	600x115	Type 2	78	9.0	1.8	900 x 950
TB088/H/FP	8m	194	114	6630	1250	600x115	Type 2	108	13.0	2.2	950 x 1100
TB108/H/FP/SP†	10m	194	140/127	8370	1250	600x115	Type 2	158	19.5	2.5	1050 x 1200
TB128/H/FP/SP†	12m	219	168/152	9840	1750	600x115	Type 3	258	36.4	3.9	1250 x 1300

 $^{^{\}star}$ Concrete dimension based on a minimum ground bearing pressure of 150kN/m², (S = square dimension, H = depth)

[†]Supplied as standard with spigot, length 230mm

[†]Supplied as standard with spigot, length 230mm

For complete information on foundation options please refer to www.abacuslighting.com/base-hinged-fixed-columns.asp

Outreach & Floodlight Brackets

		Outreach Brackets		Spigot Lengths	Floodlight Bra	ackets ØM20
		Single (S)	Double (D)	/SP 230mm		
Height	Projection Length	Overlap Fit on Shaft	Flush Fit on Spigot	Type/Bolt Centres (mm)	Overlap Fit on Shaft	Flush Fit on Spigot
5m		TB058	TB058/SP		TB058	TB058/SP
	0.30m	PR6-03/S or /D	PR7-03/S or/D	Double (800)	FL4/3	FL5/3
	0.50m	PR6-05/S or /D	PR7-05/S or/D	Triple (600)	FL4/4	FL5/4
				Triple (800)	FL4/5	FL5/5
6m		TB068	TB068/SP		TB068	TB068/SP
	0.30m	PR6-03/S or /D	PR7-03/S or /D	Double (800)	FL4/3	FL5/3
	0.50m	PR6-05/S or /D	PR7-05/S or /D	Triple (600)	FL4/4	FL5/4
				Triple (800)	FL4/5	FL5/5
8m		TB088/H	TB088/H/SP		TB088/H	TB088/H/SP
	1.0m	PR6-10/S or /D	PR7-10/S or /D	Double (800)	FL4/3	FL5/3
	1.5m	PR6-15/S or /D	PR7-15/S or /D	Triple (600)	FL4/4	FL5/4
				Triple (800)	FL4/5	FL5/5
10m			TB108/H/SP			TB108/H/SP
	1.5m	-	PR5-15/S or /D	Double (800)	-	FL3/3
	2.0m	-	PR5-20/S or /D	Triple (600)	-	FL3/4
	2.5m	-	PR5-25/S or /D	Triple (800)	-	FL3/5
				Quadruple (800)	-	FL3/7
12m			TB128/H/SP			TB128/H/SP
	1.5m	-	PR8-15/S or /D	Double (800)	-	FL7/3
	2.0m	-	PR8-20/S or /D	Triple (600)	-	FL7/4
	2.5m	-	PR8-25/S or /D	Triple (800)	-	FL7/5
				Quadruple (800)	-	FL7/7

For complete bracket information please refer to pages 37-39

Column Headload Capacity (m²) Based on UK rationalised wind loading factors for EN40

Product Code	Lantern Mounting/Projection	Max. Headload (kg)	Light 396	Medium 429	Heavy 466	Extra Heavy 576
TB058	Post Top	60	1.824	1.675	1.533	1.224
	0.50m Single Outreach	20	1.138	1.043	0.954	0.76
	0.75m Single Outreach	20	0.99	0.907	0.829	0.658
TB068	Post Top	75	1.301	1.19	1.084	0.857
	0.50m Single Outreach	20	0.903	0.825	0.751	0.592
	0.75m Single Outreach	20	0.793	0.723	0.658	0.516
TB088/H	Post Top	100	0.838	0.764	0.696	0.553
	0.50m Single Outreach	20	0.866	0.799	0.735	0.59
	0.75m Single Outreach	20	0.659	0.608	0.558	0.45
TB108/H/SP	Post Top	100	0.992	0.916	0.845	0.647
	1m Single Outreach	20	0.446	0.411	0.377	0.302
	1.5m Single Outreach	20	0.297	0.272	0.248	0.195
TB128/H/SP	Post Top	100	1.653	1.495	1.344	1.007
	1m Single Outreach	20	0.428	0.394	0.362	0.29
	2m Single Outreach	20	0.363	0.332	0.302	0.235

For complete information on column headloads refer to www.abacuslighting.com/base-hinged-fixed-columns.asp

APPENDIX 3 - ILP REDUCTION OF OBTRUSIVE LIGHT

Project Details

PROJECT: FLOODLIGHT THREE TENNIS COURTS

CLIENT: CARISBROOKE LAWN TENNIS CLUB

AREA: TENNIS COURT NRS 6 - 8

SPORTS FACILITY PLANNING AND DESIGN LIMITED

39 HEMWOOD ROAD, WINDSOR, BERKSHIRE. SL4 4YX.

TEL. 01753 850123 MOB. 07770 366259

EMAIL : OFFICE@SFPAD.CO.UK WEB : WWW.SFPAD.CO.UK



Date: 23.05.2025 Page 17 of 17



GUIDANCE NOTE 01/21

THE REDUCTION OF OBTRUSIVE LIGHT



Guidance Note

GN01/21

The Reduction of Obtrusive Light

Copyright © 2021 ILP

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means: electronic, electrostatic, magnetic tape, mechanical, photocopying, recording or otherwise, without permission in writing from the Institution of Lighting Professionals.

Institution of Lighting Professionals
Regent House
Regent Place
Rugby
Warwickshire
CV21 2PN

Tel: (01788) 576492
Email: info@theilp.org.uk
Website: www.theilp.org.uk
Registered Charity Number 268547

The Reduction of Obtrusive Light

This Guidance Note supersedes GN01/20 to reflect the changes in international guidance regarding obtrusive light as detailed in CIE 150: 2017 Guide on the Limitation of the Effects of Obtrusive Light from Outdoor Lighting Installations¹. It also considers industry comment regarding the assessment and definition of obtrusive lighting.

Good lighting practice is the provision of the right light, at the right time, in the right place, controlled by the right system.

The invention of artificial light and its application in the external environment has done much to safeguard and enhance our night-time environment but, if not properly controlled, **obtrusive light** (sometimes referred to as light pollution) can present serious physiological and ecological problems.

Obtrusive light, whether it keeps you awake through a bedroom window, impedes your view of the night sky or adversely affects the performance of an adjacent lighting installation, is a form of pollution. It may also be a nuisance in law and can be substantially mitigated without detriment to the requirements of the task.

Sky glow, the brightening of the night sky, **Glare** the uncomfortable brightness of a light source when viewed against a darker background, **Light spill** the spilling of light beyond the boundary of the area being lit and **Light intrusion ('Nuisance')**² are all forms of obtrusive light which may cause nuisance to others, or adversely affect fauna & flora as well as waste money and energy.

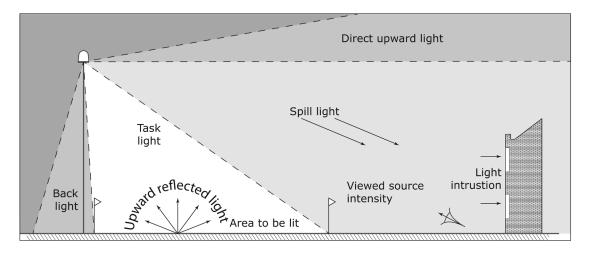


Figure 1: Types of obtrusive light

¹ The copyright of the data detailed within this guide belongs to CIE, email ciecb@cie.co.at This document should be used in conjunction with CIE 150:2017 and CIE 126:1997 and not as a replacement for the procedures contained therein. These documents can be obtained from http://cie.co.at/publications and members of a National Committee of the CIE can purchase them with a discount of 66.7 %.

² The term light trespass has been used in the past and should no longer be referenced, trespass is to physically encroach on land and light can't do that, so the term nuisance or spill light should always be used.

Considerations to be made

Think before you light. Is it necessary? What effect could it have on others? Has it the potential to cause a nuisance? How can you mitigate and manage and potential adverse effects from your lighting installation?

There are published standards and guidance for most lighting tasks adherence to these will help mitigate obtrusive lighting aspects. Organisations from which full details of these standards can be obtained are given later in this Guidance Note.

For the purpose of this Guidance Note, the following two Commission Internationale De L'Eclairage (CIE) documents are specifically referenced, which provide guidance to the mitigation of obtrusive light from exterior lighting installations:

- CIE 150: 2017 Guide on the Limitation of the Effects of Obtrusive Light from Outdoor Lighting Installations
- CIE 126: 1997 Guidelines for Minimizing Sky Glow

When considering any lighting installation then these two documents should be referenced and referred to.

Whilst this guidance Note examines the effects of external lighting installations, other factors should also be considered. Office buildings, residences and shop fronts, with extensive use of glass without blinds, screens or curtains, could become a source of illumination to the exterior environment.

"Good Design Equals Good Lighting"

It cannot be stressed sufficiently that, by employing a competent lighting designer with proven experience in the relevant application, will result in a suitable lighting installation where all obtrusive lighting aspects are mitigated³.

Any lighting scheme consists of three basic elements: a light source, a luminaire (incorporating the optical control system) and a method of installation / mounting.

³ Competency can be determined through membership of a professional lighting body supported by the appropriate qualifications and experience in the application of lighting required.

Light sources (Lamps / LEDs)

The light source output in lumens is not the same as the wattage. It is the former that is important in combating the problems of obtrusive light.

Most night-time visual tasks are only dependent on light radiated within the visual spectrum. It is therefore not necessary for light sources to emit either ultraviolet or infra-red radiation unless specifically designed to do so. The majority of light sources used in external lighting do not contain these wavelengths or where they are present their spectral power is very low.

Research indicates that light from the blue end of the spectrum could have important adverse effects on fauna and flora. The lighting designer should consider the blue light spectral power of the light source and try to balance the needs of the task to be lit with any impact on fauna and flora within the environment.

Luminaires

The choice of luminaire with the right optical distribution at the right mounting height is critical to minimising light spill and obtrusive light effects, yet providing the right lighting performance on the task area.

Sky glow is the general diffuse sheen that is visible in the direction of large cities, airports, and industrial complexes. It occurs from both natural and artificial light sources and does not depend exclusively on the lighting design. It also depends on the atmospheric conditions (humidity, aerosols, clouds, haze, atmospheric pollution, etc.). Light propagating into the atmosphere either directly from upward directed or incompletely shielded sources, or after reflection from the ground or other surfaces, is partially scattered back towards observers on the ground; the impact being shown in table 1.

Table 1: The effect on the ability to view the night sky at various angles

	Angle of light emitted (degrees)	Sky glow effect	Glare effect
100-180°	100 - 180	Local	Little
95-100° 90-95°	95 - 100	Significant	Some
85-90° 0-85°	90 - 95	High	High
0-85°	85 - 90	Significant	High
Indicative diagram	0 - 85	Minimum	Some

It is therefore important to consider the luminaire, its light distribution, how it is installed and how it is set up.


For most general sports and area lighting installations the use of luminaires with asymmetric optics is preferred. This type of optic should be designed and installed so that the front glazing is kept at or near horizontal; parallel to the surface to be lit or ground. if correctly designed, installed and aimed correctly should ensure minimising obtrusive light.

Appendices 1 and 2 give more details of how to choose, and if necessary, through the use of louvres and shields, modify luminaires.

Installation

In most cases it will be beneficial to use as high a mounting height as possible, giving due regard to the daytime appearance of the installation.

It should be noted that a lower mounting height can be worse as can be seen from figures 2 and 3 from CIE 150. A lower mounting height can create a higher level of light spill and require additional lighting points.

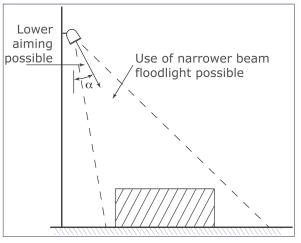




Figure 2a: Higher mounting height
- less spill light and glare

Figure 2b: Lower mounting height
- more spill light and glare

Keep glare to a minimum by ensuring that the main beam angle of all luminaires directed towards any potential observer is no greater than 70°. Higher mounting heights allow lower main beam angles, which can assist in reducing glare.

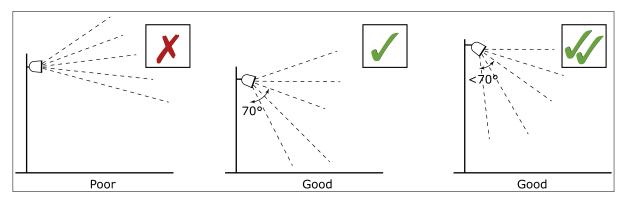


Figure 3: Luminaire aiming angles

In areas with low ambient lighting levels, glare can be very obtrusive and extra care should be taken when positioning and aiming lighting equipment. With regard to domestic security lighting, the ILP produces an information leaflet GN09:2019 "Domestic exterior lighting, getting it right!" that is freely available from its website.

When lighting vertical structures such as advertising signs, direct light downwards wherever possible. If there is no alternative to up-lighting, as with much decorative lighting of buildings, then the use of luminaires with the correct optical distribution coupled where required with shields, baffles and louvres will help reduce spill light around and over the structure to a minimum.

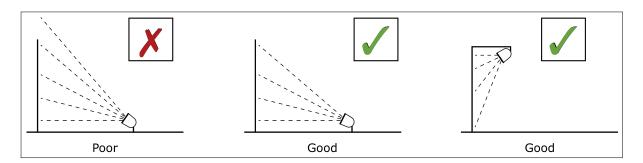


Figure 4: Façade illumination

For road and amenity lighting installations light near to and above the horizontal should normally be minimised to reduce glare and sky glow (Note the Upward Lighting Ratios (ULR's) advised in Tables 5 and 6). In rural areas the use of full horizontal cut off luminaires installed at 0° uplift will, in addition to reducing skyglow, also help to minimise visual intrusion within the open landscape. However, in some urban locations, luminaires fitted with a more decorative bowl and good optical control of light should be acceptable and may be more appropriate.

Clean Neighbourhoods and Environment Act (CNEA) 2005

The Clean Neighbourhoods and Environment Act (CNEA) 2005 gives Local Authorities and the Environment Agency additional powers to deal with a wide range of issues by classifying artificial light emitted from defined premises as a statutory nuisance.

The CNEA 2005 amended section 79(1) of the Environmental Protection Act 1990 to extend the statutory nuisance regime to include light nuisance stating the following:

'(fb) artificial light emitted from premises so as to be prejudicial to health or a nuisance'.

Guidance produced on Sections 101 to 103 of the CNEA 2005 by DEFRA (DEFRA, April 2006) extends the duty on local authorities to ensure their areas are checked periodically for existing and potential sources of statutory nuisances, including nuisances arising from artificial lighting. Local authorities must take reasonable steps to investigate complaints of such nuisances from artificial light. Once satisfied that a statutory nuisance exists or may occur or recur, local authorities must issue an abatement notice (in accordance with section 80(2) of the Environmental Protection Act 1990), requiring that the nuisance cease or be abated within a set timescale.

National Planning Policy Framework (NPPF)

The NPPF was introduced as a more concise and useable planning document to aid developers and designers in the design and construction of developments within the UK.

The National Planning Policy Framework 2019 makes little reference to lighting with regard to the control of obtrusive light, the only reference states:

c) limit the impact of light pollution from artificial light on local amenity, intrinsically dark landscapes and nature conservation.

Many Local Planning Authorities (LPAs) have already produced, or are producing, policies that within the planning system will become part of their local development framework. For new developments there is an opportunity for LPAs to impose planning conditions related to external lighting, including curfew* hours.

^{*} Curfew: The time after which stricter requirements (for the control of obtrusive light) will apply; often a condition of use of lighting applied the local planning department. Depending upon application curfew times often commence between 21:00 to 23:00 and may run until 07:00. However, exact curfew hours should be carefully applied to ensure the reduction of obtrusive light is prioritised within the immediate environment and towards sensitive human as well as fauna and flora receptors.

National Planning Policy

The national on-line planning guidance resource looks at when lighting pollution concerns should be considered;

The guidance provides a high level overview for planners with links to a few appropriate documents to give planners an overview of the subject through seven discussion points as follows:

- When is light pollution relevant to planning
- What factors should be considered when assessing whether a development proposal might have implications for light pollution
- What factors are relevant when considering where light shines
- What factors are relevant when considering when light shines
- What factors are relevant when considering how much the light shines
- What factors are relevant when considering possible ecological impact
- What other information is available that could inform approaches to lighting and help reduce light pollution

Artificial light requires consideration at the planning stage. To ensure that any proposed lighting installation conforms to the requirements of an area and its intended task, planners should consult with a competent lighting professional. The appropriate planning conditions for the project can then be established, the application reviewed, and the final performance of the installation confirmed.

The Scottish Executive has published a design methodology document (March 2007) entitled "Controlling Light Pollution and Reducing Energy Consumption", to further assist in mitigating obtrusive light elements at the design stage.

Environmental Zones

It is recommended that Local Planning Authorities specify the following environmental zones for exterior lighting control within their Development Plans.

Table 2: Environmental zones

Zone	Surrounding	Lighting environment	Examples
E0	Protected	Dark (SQM 20.5+)	Astronomical Observable dark skies, UNESCO starlight reserves, IDA dark sky places
E1	Natural	Dark (SQM 20 to 20.5)	Relatively uninhabited rural areas, National Parks, Areas of Outstanding Natural Beauty, IDA buffer zones etc.
E2	Rural	Low district brightness (SQM ~15 to 20)	Sparsely inhabited rural areas, village or relatively dark outer suburban locations
E3	Suburban	Medium district brightness	Well inhabited rural and urban settlements, small town centres of suburban locations
E4	Urban	High district brightness	Town / City centres with high levels of night-time activity

- **Note 1** Where an area to be lit lies close to the boundary of two zones the obtrusive light limitation values used should be those applicable to the most rigorous zone (see comment below)
- **Note 2** Rural zones under protected designations should use a higher standard of policy
- **Note 3** Zone E0 must always be surrounded by an E1 Zone
- **Note 4** Zoning should be agreed with the local planning authority. Due to local requirements a more stringent zone classification may be applied to protect special / specific areas
- Note 5 SQM (Sky Quality Meter) is referenced by the International Dark Skies Association (IDA). SQM is an instrument used to measure the luminance of the night sky. It is typically used by astronomers to quantify skyglow, using units of magnitudes per square arcsecond. the scale is between 16:00 (a bright night sky) and 22:00 (the least light pollution). The criteria for zone E0 was revised in mid 2019, with the new requirements not being made retrospective
- Note 6 Astronomical Observable Dark Skies will offer clearer views of the Milky Way and of other objects such as the Andromeda Galaxy and the Orion Nebula
- **Note 7** Although values of SQM 20 to 20.5 may not offer clear views of astronomical dark sky objects such as the Milky Way, these skies will have their own relative intrinsic value in the UK

Adjacent Zone Considerations

As advised in Note 1 to Table 2, where an area to be lit lies within visual distance of the boundary between two zones then the obtrusive light values applicable to the most rigorous zone shall apply. Figure 5 demonstrates this. For an observer located within or at the boundary of a more rigorous zone (E(X-1)) compared to the adjacent less rigorous zone (E(X)) then when the observer faces the less rigorous zone they will only be exposed to obtrusive lighting level pertinent to the zone within which they are located.

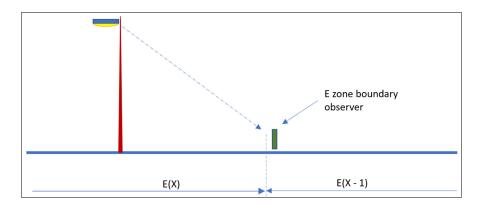


Figure 5: boundary zone considerations

Design Guidance

The following limitations based upon CIE150 may be supplemented or replaced by an LPA's own planning guidance for exterior lighting installations. As lighting design is not as simple as it may seem, you are advised to consult and/or work with a competent professional lighting designer when considering any exterior lighting.

Recommended Maximum Values of Light Parameters for the Control of Obtrusive Light

Limitation of illumination on surrounding premises

Light intrusion / nuisance

Table 3 (CIE 150 table 2): Maximum values of vertical illuminance on premises

Light technical parameter	Application conditions	Environmental zone				
		EO	E1	E2	E3	E4
Illuminance in the vertical plane (E _v)	Pre-curfew	n/a	2 lx	5 lx	10 lx	25 lx
P.G. (L _v)	Post-curfew	n/a	<0.1 lx*	1 lx	2 lx	5 lx

^{*} If the installation is for public (road) lighting then this may be up to 1 lx.

Limits apply to nearby dwellings / premises or potential dwellings / premises and specifically windows. The values are the summation of all lighting installations.

Spill light

Table 3 can also be considered for the management of spill light; however, designers must consider the task performance requirements of any adjacent lit areas and ensure that any spill light does not adversely affect these performance parameters as this could affect their safe use. This may result in a need to minimise spill and intrusive lighting values to less than might be expected for the environmental zone within which the installation lies.

Limitation of bright luminaires in the field of view

The limits for the luminous intensity of bright luminaires are dependent on the viewing distance d, (between the observer and the bright luminaire(s)) and the projected area A_p , of the bright part of the luminaire in the direction of the observer.

Table 4 shows the maximum values for the luminous intensity of luminaires in designated directions where views of bright surfaces of luminaires are likely to be a nuisance to occupants of premises, or from positions where such views are likely to be maintained, i.e. not for momentary or short-term viewing.

Table 4 (CIE 150 table 3): Limits for the luminous intensity of bright luminaires⁴

Light technical parameter	Application conditions	Luminaire group (projected area A _p in m²)							
		0 <a<sub>p ≤0.002</a<sub>	0.002 <a<sub>p ≤0.01</a<sub>	0.01 <a<sub>P ≤0.03</a<sub>	0.03 <a<sub>P ≤0.13</a<sub>	0.13 <a<sub>P ≤0.50</a<sub>	A _p > 0.5		
	E0 Pre-curfew Post-curfew	0 0	0 0	0 0	0 0	0 0	0 0		
Maximum	E1 Pre-curfew Post-curfew	0.29 <i>d</i> 0	0.63 <i>d</i> 0	1.3 <i>d</i> 0	2.5 <i>d</i> 0	5.1 <i>d</i> 0	2,500 0		
Iuminous intensity emitted by luminaire (I in cd) ⁵	E2 Pre-curfew Post-curfew	0.57 <i>d</i> 0.29 <i>d</i>	1.3 <i>d</i> 0.63 <i>d</i>	2.5 d 1.3 d	5.0 <i>d</i> 2.5 <i>d</i>	10 <i>d</i> 5.1 <i>d</i>	7,500 500		
	E3 Pre-curfew Post-curfew	0.86 <i>d</i> 0.29 <i>d</i>	1.9 <i>d</i> 0.63 <i>d</i>	3.8 <i>d</i> 1.3 <i>d</i>	7.5 d 2.5 d	15 <i>d</i> 5.1 <i>d</i>	10.000 1,000		
	E4 Pre-curfew Post-curfew	1.4 <i>d</i> 0.29 <i>d</i>	3.1 <i>d</i> 0.63 <i>d</i>	6.3 <i>d</i> 1.3 <i>d</i>	13 d 2.5 d	26 d 5.1 d	25,000 2,500		

- **Note 1** *d* is the distance between the observer and the glare source in metres;
- **Note 2** A luminous intensity of 0 cd can only be realised by a luminaire with a complete cut-off in the designated directions;
- **Note 3** A_n is the apparent surface of the light source seen from the observer position
- **Note 4** For further information refer to Annex C of CIE 150
- **Note 5** Upper limits for each zone shall be taken as those with column $A_p > 0.5$

Considerations to aid the application of Table 4 and the assessment process.

- The assessment of A_p for observers can prove difficult and will vary for all observer positions and distances.
- The above information is applicable for the consideration of a single luminaire, but where two or more luminaires are located in close proximity to each other that to the observer they appear as a single light source, then the assessment shall be undertaken based upon the combined bright surfaces of luminaires (A_p) in the direction of the observer or, from positions where such views are likely to be maintained.
- In installations that involve lighting poles, towers or columns, the luminaires will often be viewed against the night sky. The contrast between the background sky and the bright surface areas of the luminaires can be considerable. In such installations the curfew levels

⁴ Amended based upon the approach taken by NSVV Nederlandse Stichting Voor Verlichtingskunde (Dutch: Dutch Foundation for Illumination; The Netherlands) and to consider CIE150 Annex C Table C.2

set for each environmental zone shall be applied, with the exception that such installations within an E4 zone will be designed to suit the curfew requirements of an E3 zone.

Appendix 3 provides a supplementary guidance to aid the application and use of Table 4.

Limitation of the effects on transport systems

Limits apply where users of road networks are subject to a reduction in the ability to see essential information. CIE 150 2017; Table 4 gives values that are for relevant positions and for viewing directions in the path of travel.

This assessment does not just apply to road lighting installations, but to any installation where luminaires' positioning falls under the above definition i.e. luminaires visible from the road network.

For non-road lighting installations where Threshold Increment (TI) cannot be established look to GN01 Table 4 source intensity limitations.

Table 5 (CIE 150; table 4): Maximum values of Threshold Increment and viewing direction in the path of travel

Light technical parameter		Road classification ¹					
	No road lighting	M6 / M5	M4 / M3	M2 / M1			
Veiling luminance² (L _v)	0.037 cd/m ²	0.23 cd/m ²	0.40 cd/m ²	0.84 cd/m ²			
Threshold Increment	15% based on adaption luminance of 0.1 cd/m ²	15% based on adaption luminance of 1.0 cd/m ²	15% based on adaption luminance of 2.0 cd/m ²	15% based on adaption luminance of 5 cd/m²			

- **Note 1** Road classifications as given in CIE 115:2010
- **Note 2** The veiling luminance values specified in this table are based upon on a permissible TI value of 15%

Definitions:

- The measure of disability glare expressed as the percentage increase in contrast required between an object and its background for it to be seen equally well with a source of glare present. Note: Higher values of TI correspond to greater disability glare, the reduction in visibility caused by intense light sources in the field of view.
- $L_{_{\scriptscriptstyle V}}$ The luminance that would need to be superimposed on a scene in object space to reduce the scene's contrast by an amount equal to the added retinal illuminance from scattered light on the scene's retinal image. It is most commonly used to describe the contrast-reducing effect of a glare source in the field of view.

Limitation of skyglow

Table 6 (CIE 150 table 5): Maximum values of upward light ratio (ULR) of luminaires

Light technical parameter	Environmental zones							
	EO	E1	E2	E3	E4			
Upward light ratio (ULR) / %	0	0	2.5	5	15			

- **Note 1** This is the primary approach to limit skyglow and is suitable to compare different single luminaires and mitigate the contribution of each luminaire within an installation.
- **Note 2** This does not take into account the effect of light reflected upwards from ground that also contributes to skyglow.
- **Note 3** Some lighting schemes will require the deliberate and careful use of upward light, e.g. ground recessed luminaires, ground mounted floodlights and festive lighting, to which these limits cannot apply. However, care should always be taken to minimise any upward waste light by the proper application of suitably directional luminaires and light controlling attachments.

Table 7 (CIE 150 table 6): Maximum values of upward flux ratio of installation (of four or more luminaires)

Light technical parameter	Type of installation	Environmental zones				
		E0	E1	E2	E 3	E4
Upward flux ratio (UFR) / %	Road	n/a	2	5	8	12
	Amenity	n/a	n/a	6	12	35
	Sports	n/a	n/a	2	6	15

Table 7 allows the effect of both direct and reflected upward components of a whole installation to be considered. The factor being the upward flux ratio (UFR).

Note n/a within table 7 denotes that lighting of this type is not usually expected within these zones

This should only be considered where an installation consists of four or more luminaires that form an installation with a defined performance requirement or specialised fauna growth lighting systems (such as those use to promote grass growth in sports stadia) and is in proximity to:

- Optical observatories
- Lies within dark (E1) zones which abuts a protected (E0) dark sky zone

- **Note 1** The effect of distance must be considered which is a factor of the artificial lighting installation size. A small lighting installation will have an effect on an optical observatory 30km away whereas a large lighting installation of many luminaires will have an effect from a greater distance up to 100km. Specific guidance is given in CIE126 and CIE150.
- **Note 2** All external surfaces will have varying reflectances depending upon their condition and climatic conditions (wet, dry, frost etc,) as well as their varying angles, therefore the level of uncertainty in any assessment may be considerable.

Clauses 6.4.2 and 6.4.3 of CIE 150: 2017 describe the calculation methods for both ULR and UFR.

As discussed in Table 1, light emitted just above the horizontal in a zone between 80° and 110° is extra critical for skyglow in large open areas around observatories. An additional measure in these areas limits the luminous intensities (I_{80} – I_{110}) as follows:

Between 80° and 90°
 Between 90° and 100°
 Cd/1000lm

Between 100° and 110° 0 cd (0.5% of total luminaire lumens for bollard luminaires)

Note All proposed luminaires must have been photometrically measured so that results can be verified for Gamma angles 0 to 180°.

Limitations of the effect of over-lit building facades and signs

Table 8 provides recommendations regarding luminance values that provide visibility in order that a balanced urban lighting master plan can be considered. This lighting does not cause negative impacts such as a continuous increase in the lighting levels (or ratcheting) between buildings and within areas creating light pollution.

Illuminated advertising signage should be assessed as advised in the Institutions Professional Lighting Guide 05 (PLG05); The Brightness of Illuminated Advertisements.

Table 8 (CIE 150 table 7): Maximum permitted values of average surface luminance

Light technical parameter	Application conditions	Environmental zones					
		E0	E1	E2	E 3	E4	
Building façade luminance (L _b)	Taken as the product of the design average illuminance and reflectance divided by n	< 0.1 cd/m ²	< 0.1 cd/m ²	5 cd/m²	10 cd/m²	25 cd/m²	
Sign luminance (L _s)	Taken as the product of the design average illuminance and reflectance divided by π (pi), or for self-luminous signs, its average luminance	< 0.1 cd/m ²	50 cd/m²	400 cd/m²	800 cd/m²	1.000 cd/m²	

Note The values apply to both pre- and post-curfew, except that in Zones 0 and 1 the values shall be zero post-curfew. The values for signs do not apply to signs for traffic control purposes.

For illuminated advertising signs the aim should be to achieve the limits advised in PLG05.

Relevant Publications and Standards

British Standards

BS 5489-1:2020 Code of practice for the design of road lighting – Part 1 Lighting of roads and public amenity areas

BS EN 13201-2:2015 Road lighting; Part 2: Performance requirements

BS EN 13201-3:2015 Road lighting; Part 3: Calculation of performance

BS EN 13201-4:2015 Road lighting; Part 4: Methods of measuring lighting performance

BS EN 12193:2018 Light and lighting; Sports lighting

BS EN 12464-2:2014 Lighting of work places; Outdoor work places

PD CEN TR 13201-1:2014 Road lighting; Guidelines on selection of lighting classes

BS EN 12464-2:2014 Light and lighting; Lighting of work places; Part 2 Outdoor work places

CIE publications

001 Guidelines for minimizing urban skyglow near astronomical observatories

CIE 094-1993 Guide for flood lighting

CIE 112-1994 Glare evaluation system for use within outdoor sport and area lighting

CIE 115:2010 Lighting of roads for motor and pedestrian traffic

CIE 126:1997 Guidelines for Minimising Sky Glow

CIE 129:1998 Guide for lighting exterior working areas

CIE 136:2000 Guide to the lighting of urban areas

CIE 150:2017 Guide on the Limitation of the Effects of Obtrusive Light from Outdoor Lighting Installations

CIE 169:2005 Practical design guidelines for the lighting of sport events for colour

ILP publications

PLG 04 Guidance on undertaking environmental lighting impact assessments

PLG 05 The brightness of illuminated advertisements

PLG 06 Guidance on seasonal decorations and lighting column attachments

GN 09 Domestic Security Lighting: Getting it right!

SLL / CIBSE Publications

LG 01: The industrial environment (2018)

LG 04: Sports lighting

LG 06/16: The exterior environment

LGLOL Guide to limiting obtrusive light

NB: These notes are intended as guidance only. The application of the values given in the various tables should be given due consideration along with all other factors in the lighting design. Lighting is a complex subject with both objective and subjective criteria to be considered. The notes are therefore no substitute for professionally assessed and designed lighting undertaken and assessed by a competent lighting professional, where the various and maybe conflicting visual requirements need to be balanced.

© 2021 **The Institution of Lighting Professionals.** Permission is granted to reproduce and distribute this document, subject to the restriction that the *complete* document must be copied, without alteration, addition or deletion.

Acknowledgements

Allan Howard WSP (Chair)

Peter Raynham UCL

Dan Oakley South Downs National Park


Appendix 2 images acdc


Cover image Allan Howard

Appendix 1


Outdoor luminaire classification system


Based upon CIE 150:2017 and for the purpose of this and associated documents the following figures illustrate the luminaire classification (CIE 150:2017)



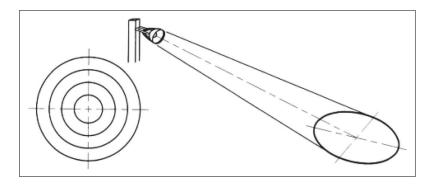



Type A flood light / projector producing a symmetrical beam



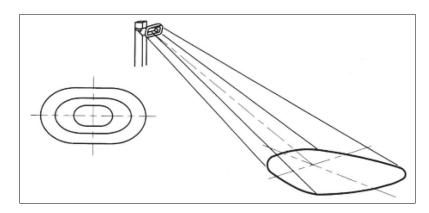

Type B flood light / projector producing a fan-shaped beam



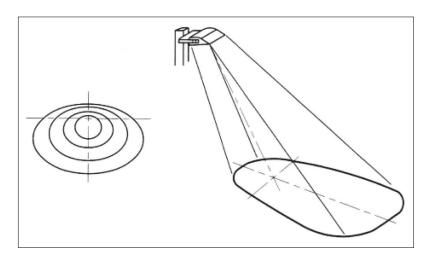

Type C flood light / projector producing a double asymmetric distribution in the vertical plane

Appendix 2

Illustrations of luminaire accessories for limiting obtrusive light



Luminaire with cowl, hood & shield





With louvre With cowl

Appendix 3

Supplementary guidance

Limits for the luminous intensity of bright luminaires

The ILP's Guidance notes for the reduction of obtrusive light 2011 and CIE 150:2003 only advised of a single limiting luminaire intensity based upon an environmental zone and pre / post curfew assessment. This approach did not take into consideration the fact that intensity is a factor of illuminance at the observer multiplied by the square of the distance to the source. As we know, the illuminance received is a factor of the inverse square law, as well as the size of the source.

GN01/20 superseded by GN01/21, as well as CIE150:2017 now take this into consideration, but with few exceptions lighting design software has yet to catch up with the requirements.

The assessment of intensity as advised within Table 4 has been developed to assist the competent professional lighting designer in making the considerations necessary. At this time, and until software is available to assist the designer, they must make their best professional judgement and undertake some manual assessments, calculations and reviews, based upon software that is currently available to determine compliance or otherwise with intensity limits and values.

This should be considered as follows:

1. Observer position (d)

The closest observer position will be the most onerous, so for any given installation determine where the most <u>realistic closest maintained observer position</u> will be. This is where the luminous intensity will be greatest, and should therefore set the limiting assessment value.

2. Determine the luminaire group (projected area A)

As can be seen in Image 1, whilst all the luminaires are of the same size, their apparent projected area A_n is different for each one from a single observer position.



Image 1: Change in projected area based upon observer position

In general, for the same observer distance (d) a luminaire with a smaller A_p will cause the greater concern regarding luminous intensity.

Where the designer knows the expected A_p of the installed luminaire, then this figure can be used to determine the luminaire group in Table 4. Where this factor is unknown then the bottom three rows of table 4 (amended below) are provided as an aid to gauging A_p and are based upon CIE150:2017 Annex C. This approach groups ranges of luminaires by diameter, extracts a geometric mean diameter for each group and provides a corresponding A_p for application (if your luminaire is square then you will need to do a calculation based upon area), so this can be used to assign the luminaire group. Whilst this is for circular luminaires the designer will need to make their best professional judgement for all shapes of luminaires and the expected A_p towards each observer.

Table 4 (CIE150 Table 3 (amended)), limits for the luminous intensity of bright luminaires⁵

Light technical parameter	Application conditions		Lumina	ire group (pro	ojected area A	ւ _թ in m²)	
·		0 <a<sub>p ≤0.002</a<sub>	0.002 <a<sub>p ≤0.01</a<sub>	0.01 <a<sub>p ≤0.03</a<sub>	0.03 <a<sub>p ≤0.13</a<sub>	0.13 <a<sub>p ≤0.50</a<sub>	A _p > 0.5
	E0 Pre-curfew Post-curfew	0 0	0 0	0 0	0 0	0 0	0 0
Maximum	E1 Pre-curfew Post-curfew	0.29 <i>d</i> 0	0.63 <i>d</i> 0	1.3 <i>d</i> 0	2.5 <i>d</i> 0	5.1 <i>d</i> 0	2,500 0
luminous intensity emitted by luminaire	E2 Pre-curfew Post-curfew	0.57 <i>d</i> 0.29 <i>d</i>	1.3 <i>d</i> 0.63 <i>d</i>	2.5 <i>d</i> 1.3 <i>d</i>	5.0 <i>d</i> 2.5 <i>d</i>	10 <i>d</i> 5.1 <i>d</i>	7,500 500
(<i>I</i> in cd)⁵	E3 Pre-curfew Post-curfew	0.86 <i>d</i> 0.29 <i>d</i>	1.9 <i>d</i> 0.63 <i>d</i>	3.8 <i>d</i> 1.3 <i>d</i>	7.5 <i>d</i> 2.5 <i>d</i>	15 <i>d</i> 5.1 <i>d</i>	10.000 1,000
	E4 Pre-curfew Post-curfew	1.4 <i>d</i> 0.29 <i>d</i>	3.1 <i>d</i> 0.63 <i>d</i>	6.3 <i>d</i> 1.3 <i>d</i>	13 <i>d</i> 2.5 <i>d</i>	26 <i>d</i> 5.1 <i>d</i>	25,000 2,500
Aid to gauging A _p Luminaire diameter		2 to 5 cm	5 to 10 cm	10 to 20 cm	30 to 40 cm	40 to 80 cm	>80 cm
Geometric mean of diameter (cm)		3.2	7.1	14.1	26.3	56.6	>80
Corresponding A _p area (m²)	representative	0.0008	0.004	0.016	0.063	0.251	>0.5

Note 6 *d* is the distance between the observer and the glare source in metres

Note 7 A luminous intensity of 0 cd can only be realised by a luminaire with a complete cut-off in the designated directions

⁵ Amended based upon the approach taken by NSVV Nederlandse Stichting Voor Verlichtingskunde (Dutch: Dutch Foundation for Illumination; The Netherlands) and to consider CIE150 Annex C Table C.2

- **Note 8** A_p is the apparent surface of the light source seen from the observer position
- **Note 9** For further information refer to Annex C of CIE 150
- **Note 10** Upper limits for each zone shall be taken as those with column $A_n > 0.5$

To aid this assessment, values of $A_{\rm p}$ corresponding to the geometric mean diameter of each circular luminaire group have been extracted from CIE150 Annex C and included within Table 3. These areas can be considered for an assessment of likely $A_{\rm p}$ in the observer direction to calculate a maximum luminous intensity value.

3. Determining the maximum luminous intensity emitted

This is just a matter of looking down the luminaire group and to the appropriate environmental zone, and determining the calculation required for pre and post curfew levels. This will advise the designer / assessor of the maximum permitted luminous intensity for that observer position and luminaire. Existing software can then be used based upon observer position and the value of intensity advised by the programme manually compared to the limited value determined from Table 4.

The additional notes b) multiple luminaires and c) luminaires viewed against the night sky within GN01/20 for the consideration of the limitation of bright luminaires in the field of view should also be considered.

Example:

1. 15 cm luminaire

We are working in an E2 zone, the luminaire has a diameter of 15cm and the realistic expected maintained nearest observer position is 100m away.

Based upon Table 4, this advises that the geometric mean of diameter is 14.1cm, and the corresponding representative A_p is 0.016. This places it within the luminaire group $0.01 < A_p \le 0.03 \text{ m}^2$ grouping. Reading down this column to E2, the pre-curfew maximum luminous intensity calculation is 2.5d where d from our case is 100m.

The limiting intensity to the identified observer is therefore $2.5 \times 100 = 250 \text{ cd}$

2 44 cm luminaire

We are working in an E3 zone, the luminaire has a diameter of 44 cm and the realistic expected maintained nearest observer is 80m away.

Based upon Table 4, this advises that the geometric mean of diameter is 56.6cm, and the corresponding representative A_p is 0.251. This places it within the luminaire

group $0.13 < A_p \le 0.50 \text{ m}^2$ grouping. Reading down this column to E3, the pre-curfew maximum luminous intensity calculation is 15d where d from our case is 80m.

The limiting intensity to the identified observer is therefore $15 \times 80 = 1,200$ cd

Assessment

In both cases these are the values the competent lighting designer needs to use within the assessment calculations. If the lighting design software is CIE150:2017 compliant it will do this, however this may require the designer to make manual assessments between intensity values advised through existing software, and the limitation required for each observer, and adjust their design until it is compliant.